

A SECTION SIMILAR TO THIS WOULD BE NEEDED TO GET THE PERVIOUS CREDIT FROM THE CITY OF BROOKHAVEN

For pedestrian applications the pavers and openings may be replaced with 3" to 4" stone

OPENINGS TO BE 3/8" TO 1/4" AND SHALL MAKE UP 10-20% OF TOTAL AREA

TYP. NO. 8 AGGREGATE IN OPENINGS

No. 89, 9, 10 may be used but not finer material

CONCRETE PAVERS MIN. 3 1/8 IN. (80 MM) THICK

CURB/EDGE RESTRAINT WITH CUT-OUTS FOR OVERFLOW DRAINAGE (CURB SHOWN)

**CURB OPTIONAL, DEPENDING ON APPLICATION**

**CITY OF BROOKHAVEN**

**NO SAND, GRAVEL, OR FINES ALLOWED TO GET 50% PERVIOUS CREDIT**

**CITY OF BROOKHAVEN**

BEDDING COURSE 1 1/2 TO 2 IN. (40 TO 50 MM) THICK (TYP. NO. 8 AGGREGATE)

No. 89, 9, 10 may be used but not finer material

4 IN. (100 MM) THICK NO. 57 STONE OPEN-GRADED BASE

GEOTEXTILE ON SIDE AND TOP OF SUBBASE

**NONWOVEN**

MIN. 6 IN. (150 MM) THICK NO. 2 STONE SUBBASE


for 50% credit, 18" (450 MM) THICK for 100% credit

NO. 3 or

OPTIONAL GEOTEXTILE ON BOTTOM

**NONWOVEN**

SOIL SUBGRADE

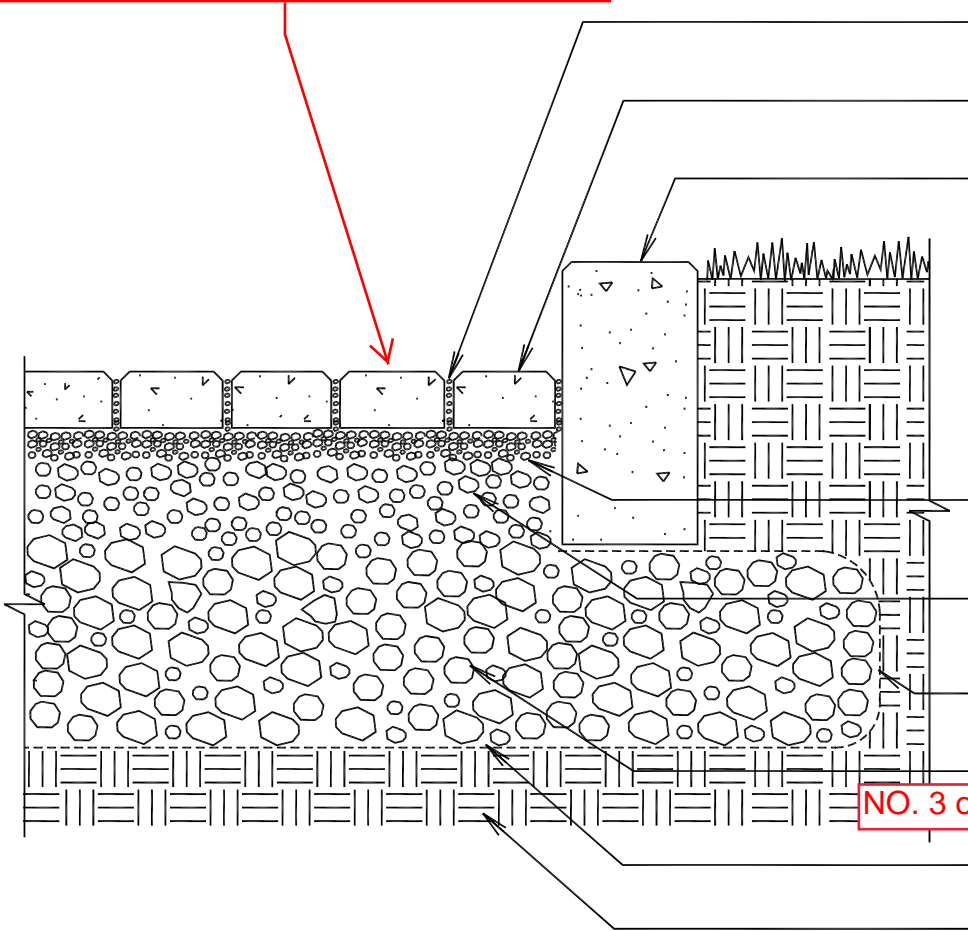


**NOTE: NO CREDIT WILL BE GIVEN FOR PAVERS ON A SLOPE GREATER THAN 5%**

NOTES:

- 2 3/8 IN. (60 MM) THICK PAVERS MAY BE USED IN PEDESTRIAN APPLICATIONS.
- NO. 2 STONE SUBBASE THICKNESS VARIES WITH DESIGN. CONSULT ICPI PERMEABLE INTERLOCKING CONCRETE PAVEMENT MANUAL.

DRAWING DATE: 4/18/2019

Updated: 9/19/2022



# PERMEABLE PAVEMENT WITH FULL EXFILTRATION TO SOIL SUBGRADE

DRAWING NO.



SCALE

NO SCALE