


ADDENDUM #2

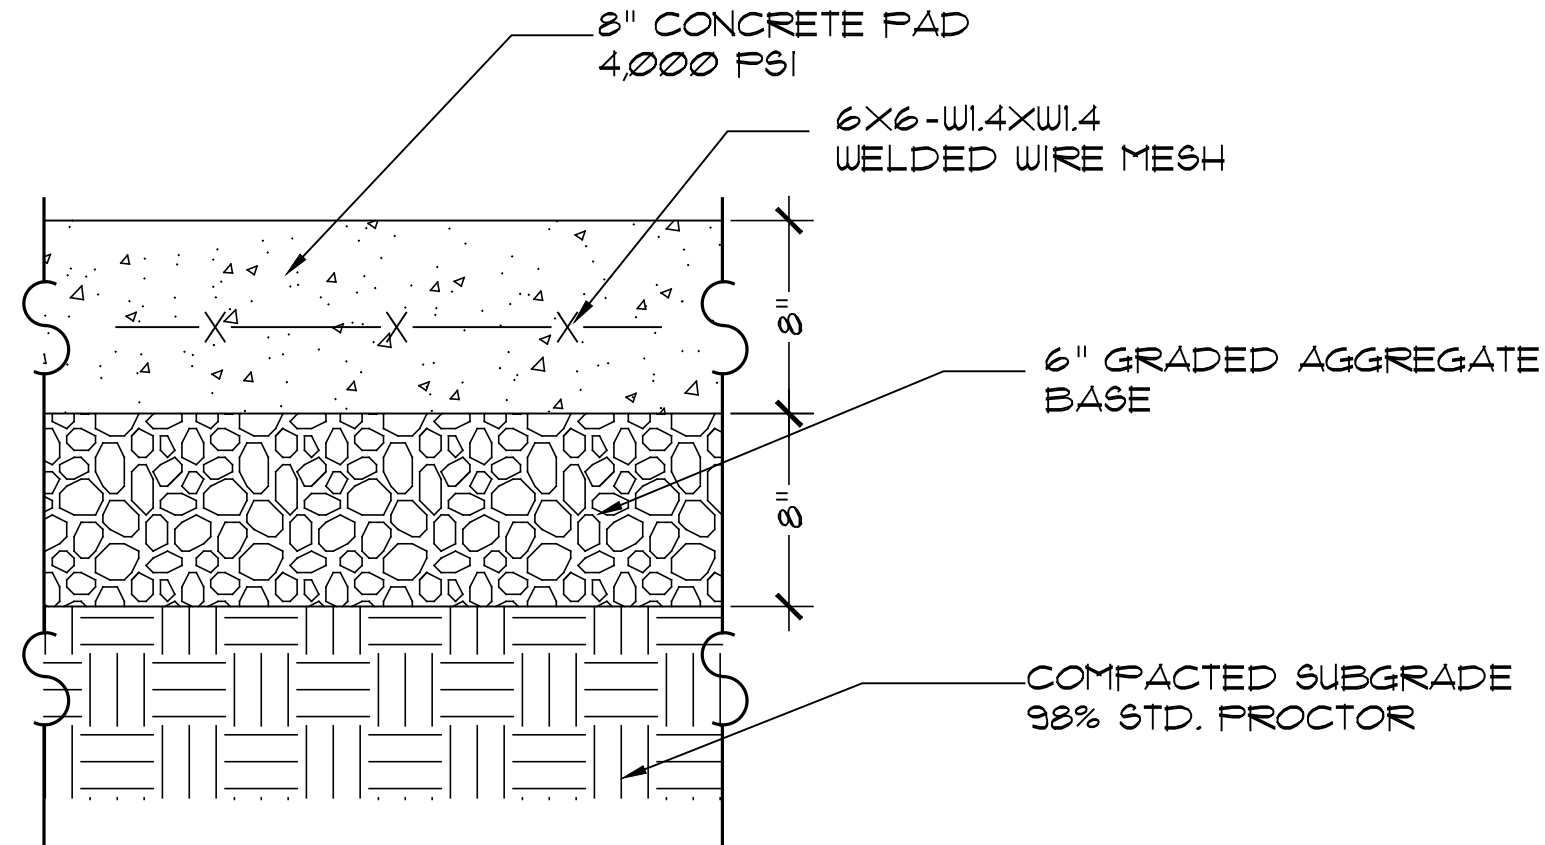

NOTES:

1. CONCRETE SHOULD BE AIR ENTRAINED WITH MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AFTER 28 DAYS PER ASTM C-31.
2. REINFORCEMENT DOWELS WITH EPOXY REQUIRED AT JOINTS.
3. MAXIMUM CONTROL JOINT SPACING 15'X15'. MINIMUM SAW-CUT DEPTH 2".
4. GRADED AGGREGATE BASE SHALL CONFORM TO THE GDOT MATERIAL SPECIFICATION SECTION 815.
5. SCARIFICATION AND MOISTURE ADJUSTMENT WILL LIKELY BE REQUIRED TO ACHIEVE THE RECOMMENDED COMPACTION LEVEL OF SUBGRADE SOILS.
6. WELDED WIRE MESH SHALL BE CENTERED IN THE SECTION USING "CHAIRS" TO RAISE FROM BASE. MINIMUM COVERAGE SHALL BE 2".

SECTION

(X) DUMPSTER PAD – HEAVY DUTY CONCRETE

1/8" = 1'-0"